

PJM RTEP-2016 RTEP Proposal Window #3

Anson 345 kV Station Project

A Proposal to PJM Interconnection November 15, 2016

Submitted by

Transource® Energy, LLC

1 Riverside Plaza, Columbus, Ohio 43215-2372



Table of Contents

A. Executive Summary.....	1
A.1. General Description of Proposed Project	1
A.2. Reliability Problem(s) Proposed to Resolve	1
A.3. Overall Schedule Duration	2
A.4. Overview of Estimate	2
A.5. Designated Entity Statement of Intent	2
A.6. Designated Entity Status/Pre-Qualification	2
B. Company Evaluation Information.....	3
B.1. Transource Contacts	3
B.2. Transource Qualifications	3
B.3. Overview of Transource Energy	4
C. Proposed Project Constructability Information.....	6
D. Analytical Assessment.....	7
E. Cost	8
F. Schedule	9
G. Operations/Maintenance	10
G.1. Operational Plan	10
G.2. Maintenance Plan	10

A. Executive Summary

Transource® Energy, LLC (Transource) is pleased to provide the following proposal to PJM in response to the *PJM RTEP-2016 RTEP Proposal Window #3 Problem Statement & Requirements Document*. Transource was specifically formed as a joint venture between subsidiaries of American Electric Power Company (AEP) and Great Plains Energy Incorporated (GPE) to participate in competitive processes for transmission development and to provide benefits to transmission customers through the planning, construction, and ownership of high quality, low cost transmission infrastructure. Transource is located at 1 Riverside Plaza in Columbus, Ohio.

A.1. General Description of Proposed Project

Transource proposes to build the Anson 345 kV Station Project (or, the Project) in northern Kentucky. The Project will establish a new Anson 345 kV station cutting into multiple 345 kV lines in the area. Lines to be cut into Anson include the existing Miami Fort-Terminal 345 kV line, the East Bend-Terminal 345 kV line, and the Tanners Creek-East Bend 345 kV line. The cut-in of the Miami Fort-Terminal 345 kV line will require approximately 0.6 miles of new double circuit 345kV line. The cut-ins of the other two lines will be one to three spans each.

Transource has completed the necessary preliminary project development work to determine project constructability, preliminary cost estimates, and a conceptual project schedule. Experienced AEP engineering, siting, permitting, project management, and construction personnel were the primary resources for this work.

A.2. Reliability Problem(s) Proposed to Resolve

The Project addresses the planning criteria violation(s) listed below:

2021 PJM Winter Analysis Generation Deliverability Result														
FG #	Fr Bt	Name	To Bt	Name	CKT	KVs	Areal	Ratin	FN DC	FN AC	Cont Label	Cont Ty	Conductor Rating (MVA)	Comment
41	243233	OSTANNER	249567	OBM.FORT	1	345/345	205/212	1600	124.55	129.72	'DEQB&K P1-* P2-1 TERMINAL-EAST BEND 4516'	single	Rate A/B = 1894/1894	related (Tanner Creek 1,2,3,4 -> 988MW) AC Loading should be 100.3%. Retirement

Table 1. Addressed Contingencies Identified by PJM

The generation deliverability thermal overload on Tanners Creek-Miami Fort 345 kV is alleviated with this Project by providing a switching station that terminates multiple 345 kV lines

in the area that resolves the contingency causing the overload on the Tanners Creek-Miami Fort 345 kV line.

Furthermore, Transource performed analysis of existing and new contingencies that the Project may create and found no planning criteria violations.

A.3. Overall Schedule Duration

The overall schedule duration is expected to 36 months after award by PJM. Assuming a project award date of April 1, 2017, Transource could place the project in-service April 2020. Please refer to Section F of this proposal for more details on the proposed schedule.

A.4. Overview of Estimate

The estimated capital cost of the Project in 2016 dollars is \$14,506,643. This estimated cost includes all Project components, including work that PJM may consider as upgrades. Please refer to Section E of this proposal for details on the project cost.

A.5. Designated Entity Statement of Intent

Transource seeks to be considered the Designated Entity for the project described within this proposal to design, construct, own, operate, and maintain the facilities and assets, subject to determination regarding components deemed upgrades by PJM.

A.6. Designated Entity Status/Pre-Qualification

Transource has been pre-qualified to be a Designated Entity for transmission projects in PJM under section 1.5.8 (a) of the PJM Operating Agreement. The pre-qualification information is contained in the document submitted to PJM on April 29, 2013, entitled *Pre-Qualification Application of American Electric Power and Certain Affiliates*. This document is on record with PJM and posted on the PJM website, with PJM pre-qualification ID of 13-05. PJM confirmed the pre-qualified status of Transource in a letter dated July 7, 2013. As required annually, Transource has reviewed this information and an Addendum to this posted document was submitted to PJM on September 30, 2016. PJM reaffirmed the pre-qualified status of AEP in a letter dated October 27, 2016.

B. Company Evaluation Information

Transource Energy, LLC is located at 1 Riverside Plaza in Columbus, Ohio. Specific contact information is provided below.

B.1. Transource Contacts

Primary Contact	Robert Cundiff Manager, Transource Business Development	Transource Energy, LLC 1 Riverside Plaza Columbus, Ohio 43215-2372 Telephone: 614-716-2076 Email Address: rjcundiff@aep.com
Secondary Contact	Takis Laios Manager, Transmission Asset Strategy	Transource Energy, LLC 1 Riverside Plaza Columbus, Ohio 43215-2372 Telephone: 614-716-3462 Email Address: tlaios@aep.com

B.2. Transource Qualifications

Transource has been pre-qualified to be a Designated Entity for transmission projects in PJM under section 1.5.8 (a) of the PJM Operating Agreement. The pre-qualification information is contained in the document submitted to PJM on April 29, 2013, entitled *Pre-Qualification Application of American Electric Power and Certain Affiliates*. This document is on record with PJM and posted on the PJM website, with PJM pre-qualification ID of 13-05. PJM confirmed the pre-qualified status of Transource in a letter dated July 7, 2013. As required annually, Transource has reviewed this information and an Addendum to this posted document was submitted to PJM on September 30, 2016. PJM reaffirmed the pre-qualified status of AEP in a letter dated October 27, 2016

Transource will bring to bear the talents, resources, and capabilities of AEP, GPE, and their respective subsidiaries to execute the Project. These capabilities are detailed in Transource's prequalification submittal to PJM.

B.3. Overview of Transource Energy

Transource was formed to pursue the development of competitive transmission projects in marketplaces initiated by the implementation of FERC Order No. 1000. AEP owns 86.5 percent of Transource, and GPE owns 13.5 percent. The combined strengths of AEP and GPE in engineering, project management, procurement, project development, construction, operation and maintenance will result in effective and efficient delivery of transmission solutions that benefit transmission customers.

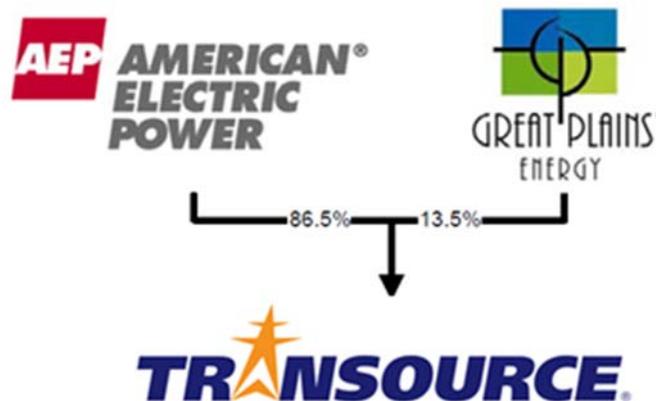


Figure 1. Summary of Transource Ownership Structure

Transource is currently developing two Southwest Power Pool (SPP) approved transmission projects in the state of Missouri through its subsidiary Transource Missouri LLC (Transource Missouri). The Iatan-Nashua 345 kV transmission project was recently placed into service, and the Sibley-Nebraska City 345 kV transmission project is currently under construction. Transource received approval from the Federal Energy Regulatory Commission (FERC) of a formula rate and certain incentives for Transource Missouri in FERC Docket No. ER12-2554. Also, Transource Missouri received approval from the Missouri Public Service Commission of a settlement filed in File No. EA-2013-0098 for a line Certificate of Convenience and Necessity to finance, construct, own, operate and maintain these projects.

In addition to these Missouri projects, Transource was recently awarded PJM’s largest-ever market efficiency project on the Pennsylvania-Maryland border in the eastern portion of PJM. Transource is also developing the Thorofare Creek Area Project in central West Virginia as part of PJM’s 2014 Regional Transmission Expansion Plan.

The figure below provides a snapshot of the states in which Transource’s owners, AEP and GPE, currently own or are developing transmission assets.

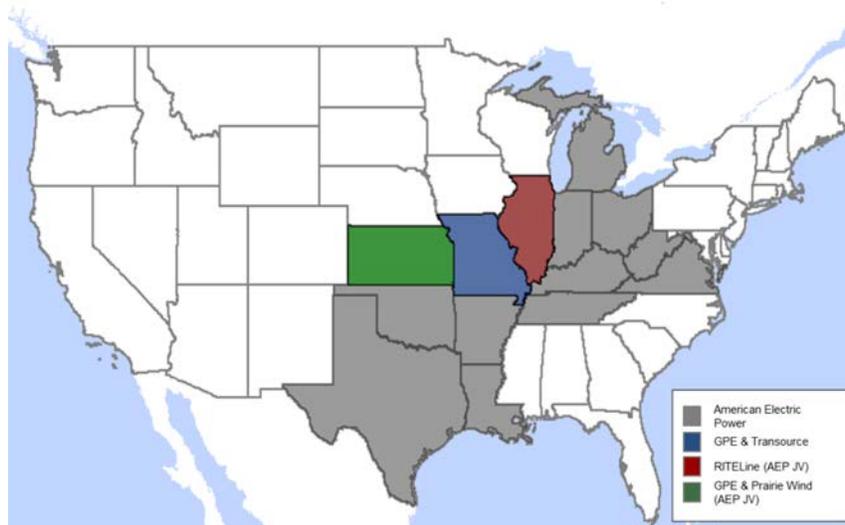


Figure 2. Combined Transmission Presence

C. Proposed Project Constructability Information

[REDACTED]

D. Analytical Assessment

[REDACTED]

E. Cost

[REDACTED]

F. Schedule

[REDACTED]

G. Operations/Maintenance

G.1. Operational Plan

Transource is flexible regarding Project operations that can be provided using one of the following approaches:

- Transource can operate the new facilities directly using the capabilities of the AEP Transmission Operations (TOPs) organization.
- Transource can work with the incumbent transmission owner to facilitate their operations of the new facilities.

The TOPs organization operates from a state-of-the-art System Control Center (SCC) located in New Albany, Ohio. AEP TOPs also operates five Transmission Operations Centers that coordinate transmission switch orders and interface with field personnel. The SCC and Transmission Operations Centers are staffed with NERC and PJM-Certified operators.

Operator tools include a State Estimator covering AEP's 11-state transmission system, real-time contingency analysis, and visualization and situational awareness tools. TOPs has a back-up control center that can be staffed and fully functional within one hour from declaration of an emergency. TOPs completes approximately 18,000 switching jobs totaling over 200,000 switching steps with an accuracy rate exceeding 99.99 percent annually.

G.2. Maintenance Plan

[REDACTED]

TRANSOURCE® ENERGY, LLC

1 Riverside Plaza
Columbus, Ohio 43215
P 614-716-2884

E info@TransourceEnergy.com
www.transourceenergy.com

