



Electric Storage Participation




Laura Walter
Sr. Lead Economist
PJM Advanced Analytics Department
Markets and Reliability Committee
October 25, 2018

- November, 2016: FERC Notice of Proposed Rulemaking on Energy Storage and Distributed Energy Resources.
- February, 2018: FERC [final rule on storage](#) ...
 - **Filing due Dec 3, 2018.**
 - Implementation due Dec 3, 2019.
 - » Order: <http://pjm.com/-/media/documents/ferc/orders/2018/20180215-rm16-23-000.ashx>
 - » PJM Request for Clarification: <http://pjm.com/-/media/documents/ferc/filings/2018/20180316-rm16-23-000-ad16-20-000.ashx>

- Electric Storage Resource (**ESR**)= “a resource capable of receiving electric energy from the grid and storing it for later injection of electric energy back to the grid.”
- Connected at: transmission, distribution, or behind a customer meter.
 - PJM has ESR at both T and D today, none behind a meter **that inject.**
- Excludes demand response.
- Includes pumped hydro

Over 5,300 MW of Electric Storage Resources currently in PJM

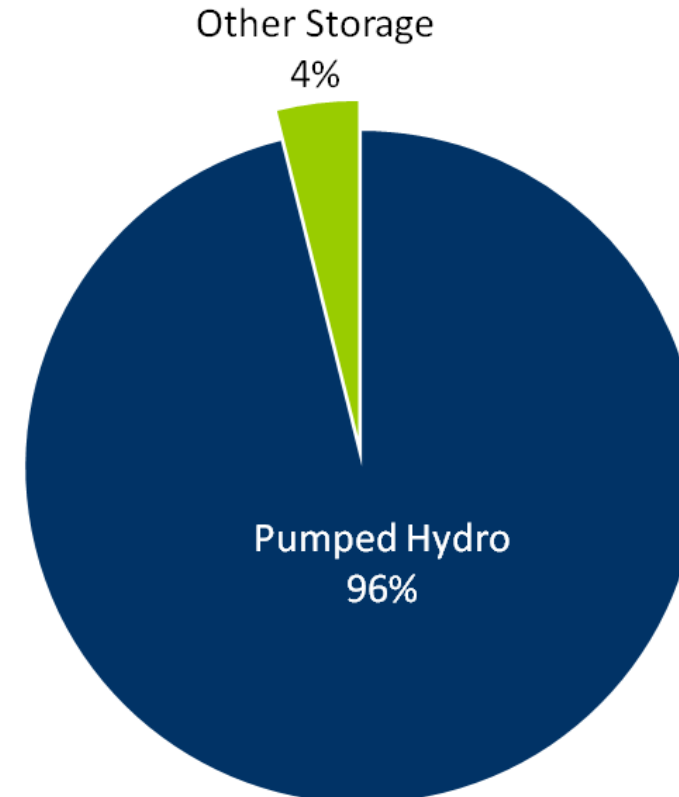


** Data taken from Generation Queue and EIA 860

1. Can sell* energy, Capacity, and A/S (incl. Black Start etc.)
the resource is technically capable of providing
2. Dispatched and sets price as seller and buyer
3. Bid parameters that account for ESR characteristics
4. Min market threshold is 100 kW
5. Stored MWh are billed at LMP as wholesale

* *“Eligible to provide...”*


- ESRs will be modeled as one continuous resource
- PJM will not make commitment decisions in the ESR model and not manage state of charge
 - Start and no load cost will not be considered
- 3 modes of operation:
 - Continuous, Charge & Discharge
- Parameters
 - Offered in through Markets Gateway
 - Max/Min charge/discharge, etc
 - Ramp considered infinite only in continuous mode

Price	MW
\$ 10.00	20
\$ 9.00	15
\$ 8.00	10
\$ 7.00	5
\$ 6.00	0
\$ 5.00	0
\$ 4.00	0
\$ 3.00	-5
\$ 2.00	-10
\$ 1.00	-15

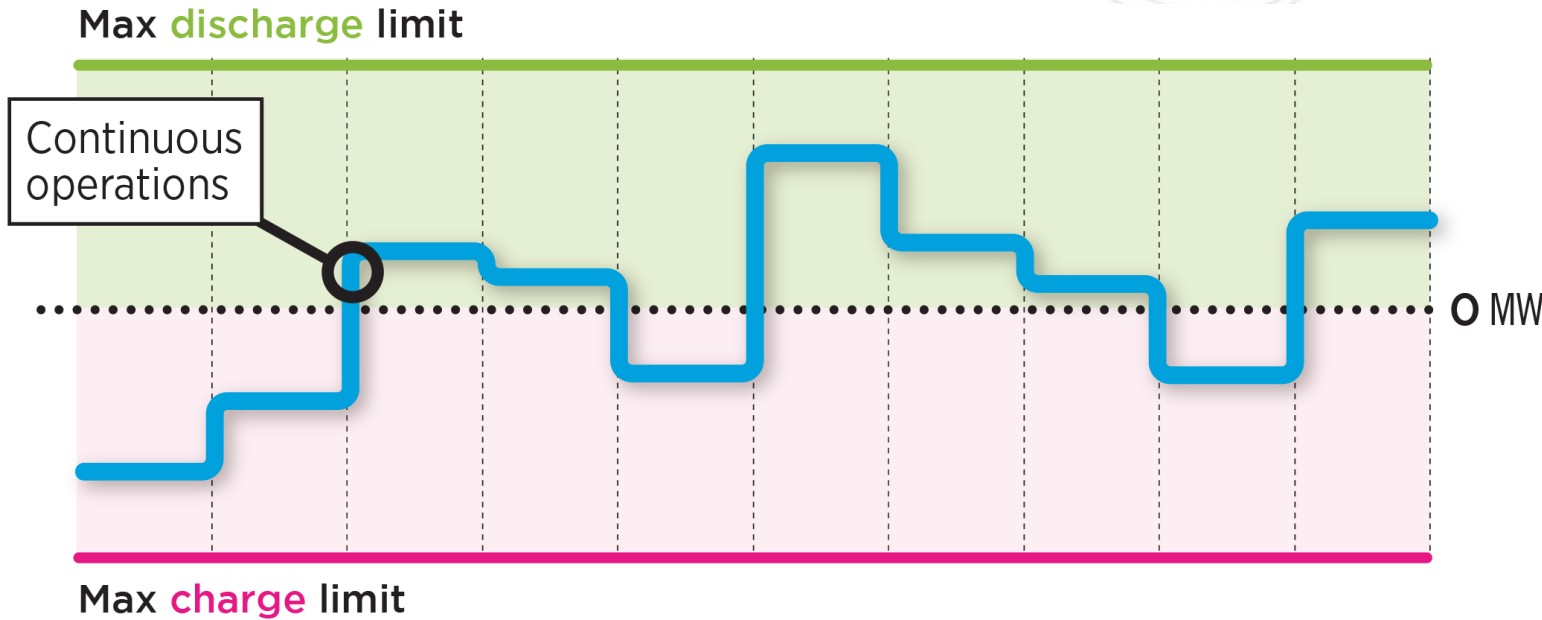


Continuous operation mode - ESRs can update their max charge and discharge limits hourly in day-ahead and more frequently in real-time.

** State of charge telemetry will be requested for telemetered resources

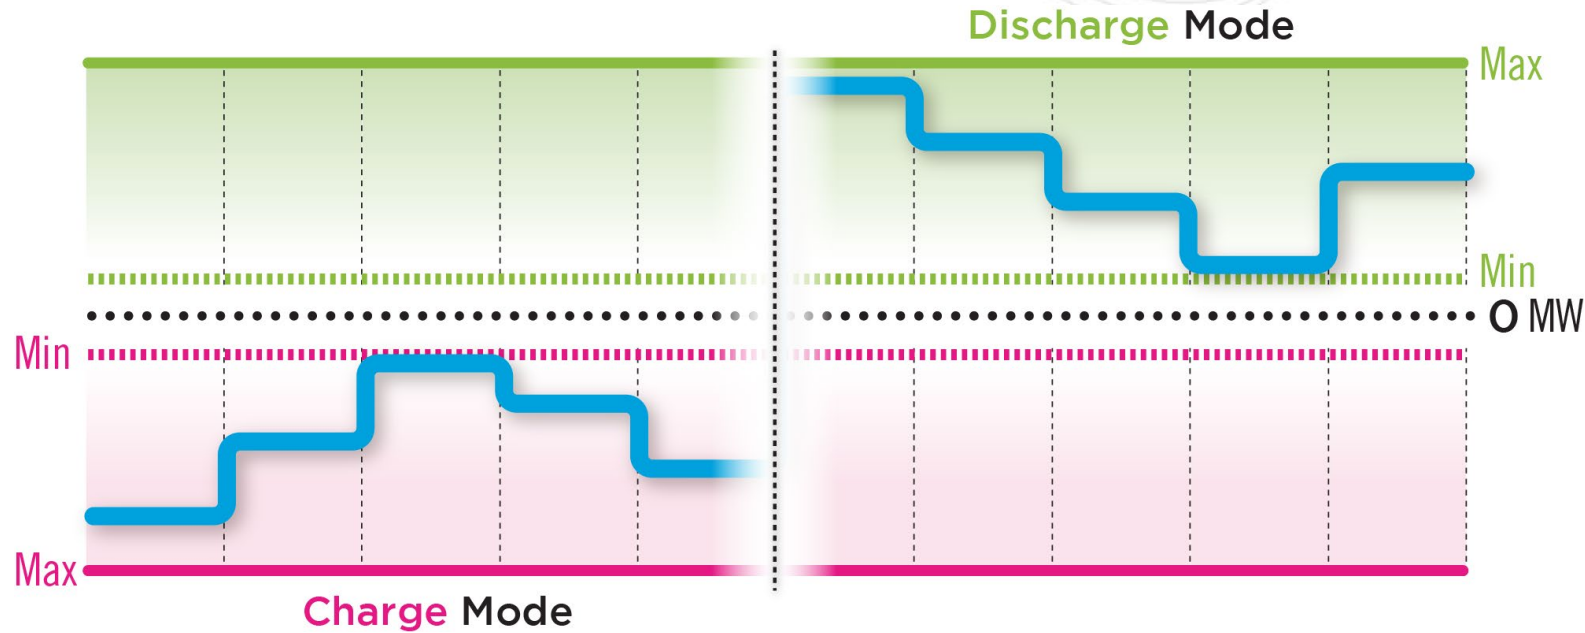

Charge & Discharge mode will be available to ESR resources in DA and RT

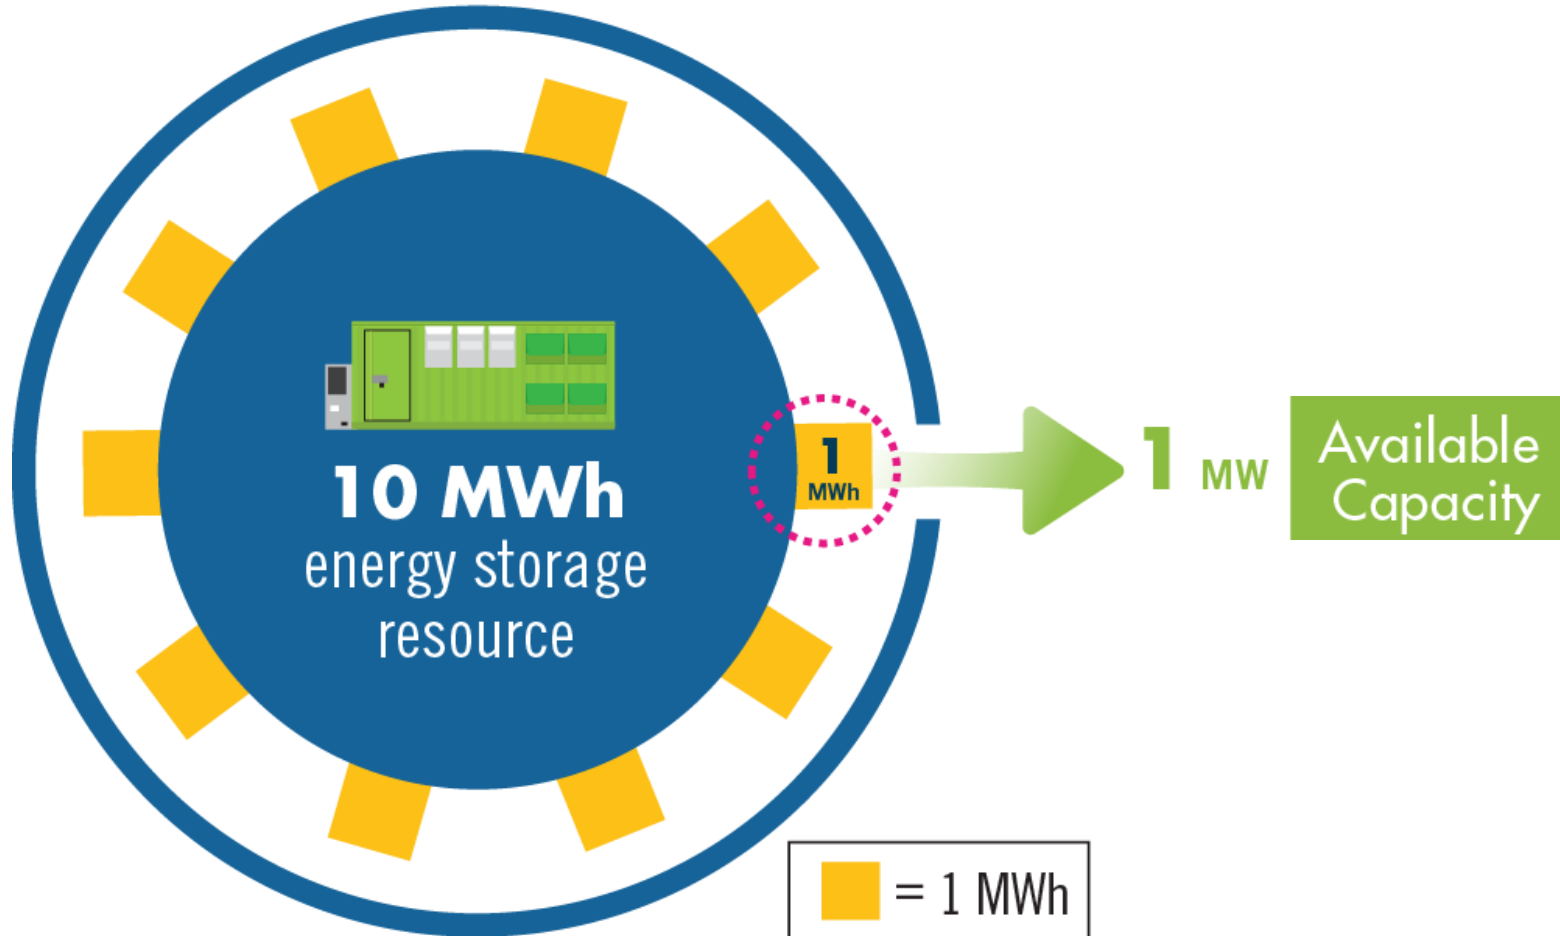

PJM proposes that status quo, per manual 21, of a minimum of 10 hour duration is maintained in the capacity market.

Questions or Feedback?

esr@pjm.com