



Market Efficiency Process Scope and Input Assumptions

Nicolae Dumitriu
Principal Engineer, Market Simulation
PJM Interconnection

July 2023

For Public Use

This page is intentionally left blank.

Contents

Scope	1
Market Simulation Model and Input Assumptions	1
<i>Fuel Cost</i>	1
<i>Peak Load and Annual Energy</i>	2
<i>Demand Response</i>	2
<i>PJM Generation</i>	3
<i>Emission Allowance Price</i>	3
<i>Financial Parameters – Carrying Charge Rate and Discount Rate</i>	5
Input Assumption Sensitivities	5
<i>Load Forecast Sensitivity</i>	5
<i>Gas Forecast Sensitivity</i>	6
<i>Generation Sensitivity – Facility Study Agreement (FSA) Level</i>	7
<i>Evaluation of Generation Trends</i>	7

Scope

Market Efficiency analysis is performed as part of the overall Regional Transmission Expansion Planning Process (RTEP) to accomplish the following objectives:

- Determine which reliability-based transmission projects, if any, have an economic benefit if accelerated or modified.
- Identify new transmission projects that may result in economic benefits.
- Review cost and benefits of economic-based transmission projects included in the Regional Transmission Expansion Plan (RTEP) to assure that they continue to be cost beneficial.
- Identify economic benefits associated with modification of reliability-based transmission projects already included in the RTEP that when modified would relieve one or more economic constraints. Such projects, originally identified to resolve reliability criteria violations, may be designed in a more robust manner to provide economic benefits as well.

Market Efficiency analysis is conducted using market simulation software, which models the market conditions and the hourly security-constrained commitment and dispatch of generation over a future annual period. Economic benefits of transmission upgrades are determined by comparing results of simulations with and without the proposed transmission enhancement or expansion. For the 2022/2023 Market Efficiency cycle, market simulations will be performed for the following years: 2023, 2027, 2030 and 2033. A forecast of annual benefits for years beyond 2033 will be based on an extrapolation of the years 2023, 2027, 2030 and 2033 simulation results. Market simulations may be performed for year 2037 to validate the extrapolation results.

Market Simulation Model and Input Assumptions


The primary analytical software used by PJM to determine potential Market Efficiency benefits is PROMOD IV from Hitachi Energy. PROMOD IV is a production costing software application that simulates the hourly commitment and dispatch of generation to meet input load while recognizing and maintaining transmission system security limits. The underlying source of the initial PROMOD IV input database is the Simulation Ready Data from Hitachi Energy. Data includes generating unit characteristics, fuel costs, emissions costs, load forecasts and a power flow case. The Simulation Ready Data for the 2022/2023 Market Efficiency cycle is from the Fall 2021 base case release with Hitachi Energy fuel and emission updates consistent with the Spring 2023 release. PJM does tailor key aspects of the base release for RTEP Market Efficiency evaluation. These items would include an update of the power flow case, a generation modification because of additional queued units and announced retirements, and the utilization of the most recent load forecasts.

Fuel Cost

The PROMOD database contains a fuel cost forecast for each fuel type. The forecast prices for each fuel are developed by the Hitachi Energy Fuels Group. For gas and oil, the prices are derived from a combination of NYMEX forward prices and a fundamental forecasting model. The coal forecasting model uses numerous factors such as mining costs, transportation routes and pricing, and coal quality to derive a coal forecast. The resulting coal price forecast is on a plant-specific delivered basis.

Figure 1 shows the average annual forecast values for light oil, heavy oil, natural gas and coal. The natural gas prices depicted are representative of the commodity cost. PROMOD uses basis adders to capture the gas transportation costs of the commodity to the different PJM zones. The oil prices are representative of burner tip prices and are the same throughout PJM. The coal prices in **Figure 1** are the average of each PJM coal plant’s burner tip price. The coal price forecast is on an individual plant-specific delivered basis.

Figure 1. Fuel Price Assumptions

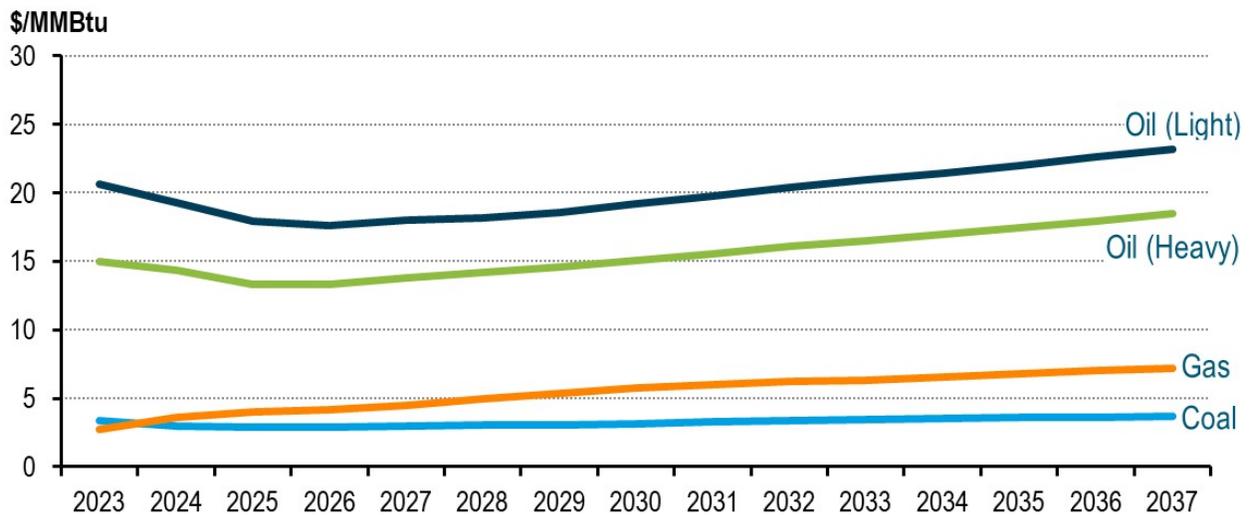

Peak Load and Annual Energy

Peak load and annual energy forecasts for the PJM RTO were developed by PJM’s Resource Adequacy Planning Department and released in the January 2023 PJM Load Forecast Report. **Table 1** shows the annual PJM peak and annual energy forecast that provides the basis for load input into the simulation.

Table 1. 2023 PJM Peak Load and Energy Forecast

Load	2023	2027	2030	2033	2037
Peak (MW)	149,059	154,275	157,899	160,971	165,976
Energy (GWh)	788,050	841,514	878,461	909,622	949,166

Demand Response

Table 2 shows the level of demand response resources available for each of the Market Efficiency study years. The values are consistent with the 2023 Load Forecast Report.

Table 2. 2023 PJM Demand Resource Forecast


	2023	2027	2030	2033	2037
Demand Resource (MW)	7,288	7,573	7,679	7,758	7,917

PJM Generation

Figure 2 shows a comparison of the modeled generation capacity within PJM’s footprint to the projected peak net internal demand with reserve margin. The modeled capacity (blue line) includes capacity that is in-service plus active queue generation with Interconnection Service Agreements (ISA) minus announced future deactivations. No Facility Study Agreement (FSA) or Suspended ISA resources were included in the base case at time of posting of this document.

The net internal demand (green line) is derived from information included in the 2023 PJM Load Forecast Report and is equivalent to the PJM Summer unrestricted peak forecast minus the projection of load management placed under PJM control.

Figure 2. PJM Market Efficiency Reserve Margin With Uniform Expansion

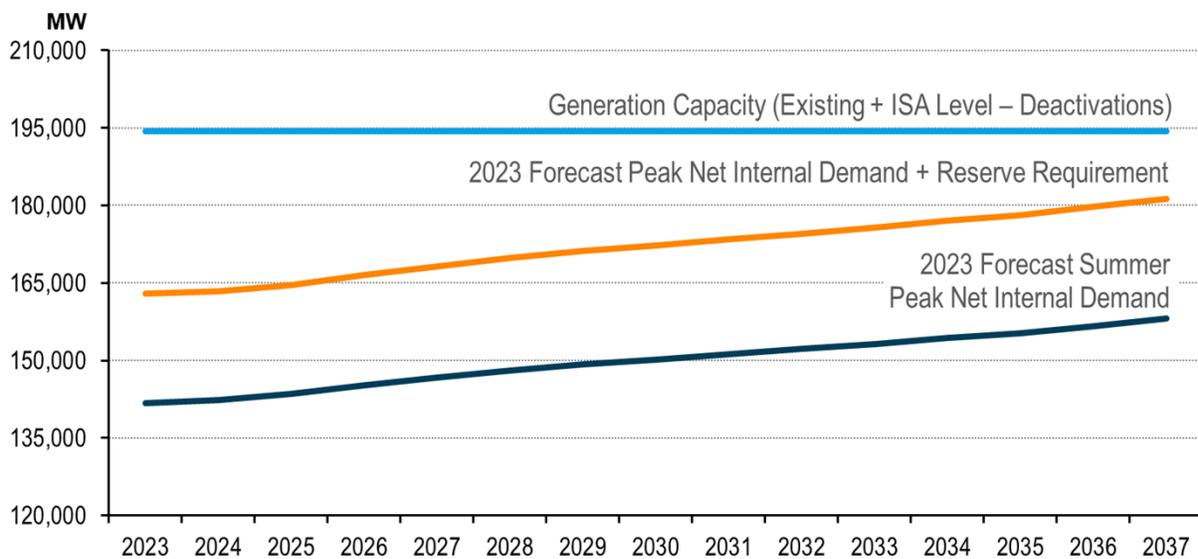


Notes: Generation includes existing and projected PJM internal capacity resources.
 Unit-level solar and wind resource capacity at 38% and 13% of maximum capability, respectively.
 Model informed by the 2027 RTEP Powerflow and the Generation Interconnection Queue (queue status as of Jan. 24, 2023)

Emission Allowance Price

The PROMOD database models three major effluents: CO₂, NO_x, and SO₂. Effluents (by trading program) are assigned to generators based on generator location, and release rates are from a variety of sources including EPA CEMS data and the forecasted fuel used. Hitachi Energy uses a proprietary Emission Forecast Model (EFM) to simulate emission control decisions and simultaneously results in the three cap-and-trade market price forecasts (NO_x Annual, NO_x Seasonal, SO₂). Hitachi Energy uses a CO₂ emission forecast based on analysis associated with national and regional legislative proposals.

The forecast of a national CO₂ emission price reflects the current federal legislation regarding greenhouse gases. Accordingly, the national CO₂ emission prices are set to zero for all study years. Currently, Maryland, Delaware, New Jersey, Virginia and Pennsylvania participate in the Regional Greenhouse Gas Initiative (RGGI). The Spring 2023 Forecast has Pennsylvania starting the program in 2024, and Virginia leaving the program in 2024. Forecast prices for RGGI CO₂ are shown in **Figure 3**.

Figure 3. CO₂ Emission Price Assumption

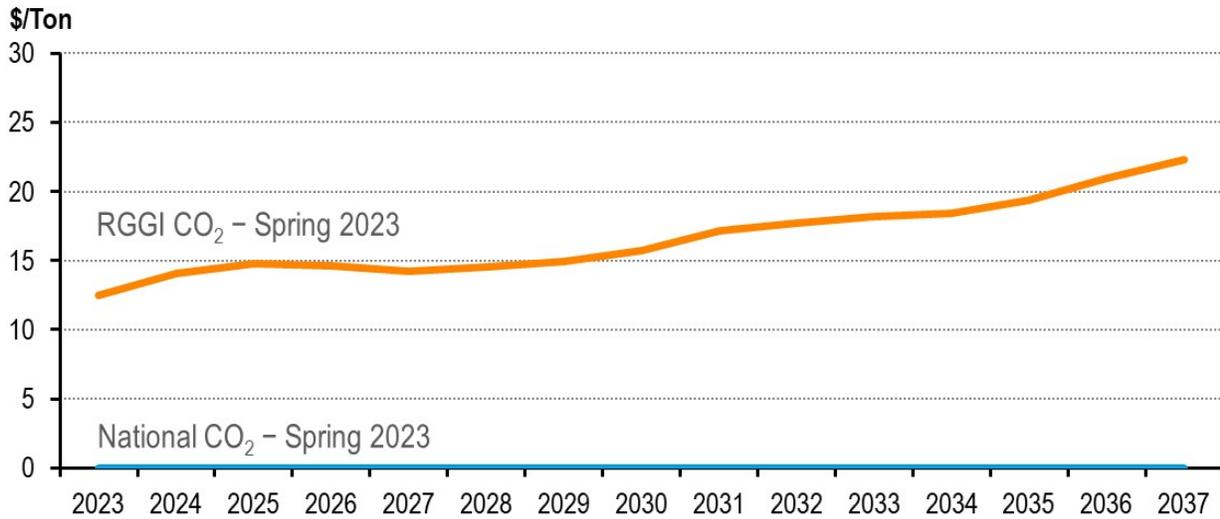

Forecasts for NO_x and SO₂ reflect legislation associated with the Cross State Air Pollution Rule (CSAPR). **Figure 4** and **Figure 5** show graphs of NO_x and SO₂ prices assumed in the Market Efficiency base case. Because of inclusion of the Good Neighbor Rule update, the Spring 2023 forecast for CSAPR Seasonal NO_x has increased significantly.

Figure 4. NO_x Emission Price Assumptions

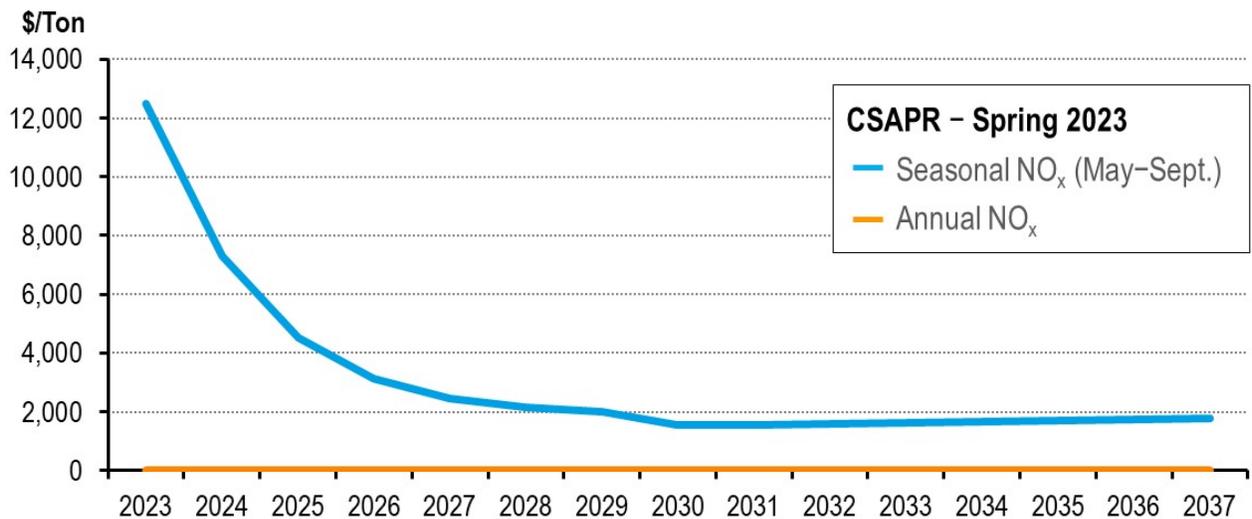
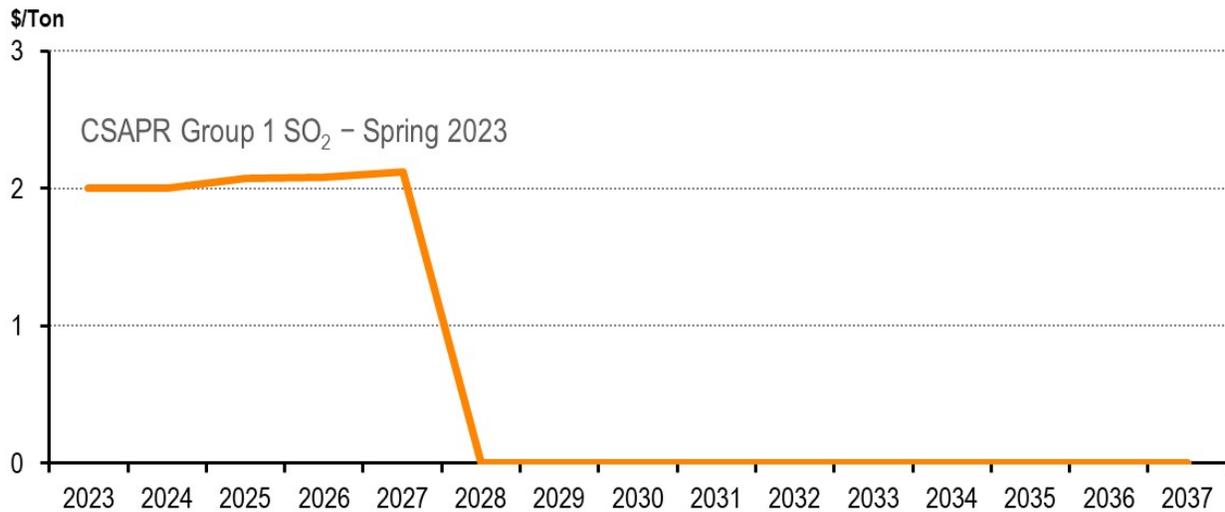


Figure 5. SO₂ Emission Price Assumption


Financial Parameters – Carrying Charge Rate and Discount Rate

Evaluation of proposed Market Efficiency projects requires a benefit-to-cost analysis. As part of this evaluation, the present value of annual benefits projected for a 15-year period starting with the RTEP year are compared to the present value of the annual cost for the same period. If the benefit-to-cost ratio exceeds a threshold of at least 1.25:1, then the project can be recommended for inclusion in the PJM RTEP. The annual cost of the upgrade will be based on the total capital cost of the project multiplied by a levelized annual carrying charge rate. A discount rate will be used to determine the present value of the project’s annual costs and annual benefits. The annual carrying charge rate and discount rate are developed using information contained in the transmission owners’ formula rate sheets and incorporated in the [Transmission Cost Information Center \(TCIC\)](#) workbook. The annual carrying charge rate and discount rate for this year’s analysis will be 11.81% and 6.81%, respectively.


Input Assumption Sensitivities

Consistent with Schedule 6 of the PJM Operating Agreement, sensitivities of future assumptions are considered within the Market Efficiency project selection process in order to mitigate the potential for inappropriately including or excluding Market Efficiency projects. PJM typically will study impacts of load forecast variations and fuel cost variations on eligible proposals. Also, generation additions to the PJM system will be considered.

Load Forecast Sensitivity

A +/- 2% variation of the base PJM load forecast model is used to test the robustness of eligible solution proposals. **Figure 56** shows a graph of PJM’s annual energy forecast for the base case and the two sensitivity cases (2% PJM load reduction and 2% PJM load increase) for years 2023 through 2037.


Figure 6. Load Sensitivity

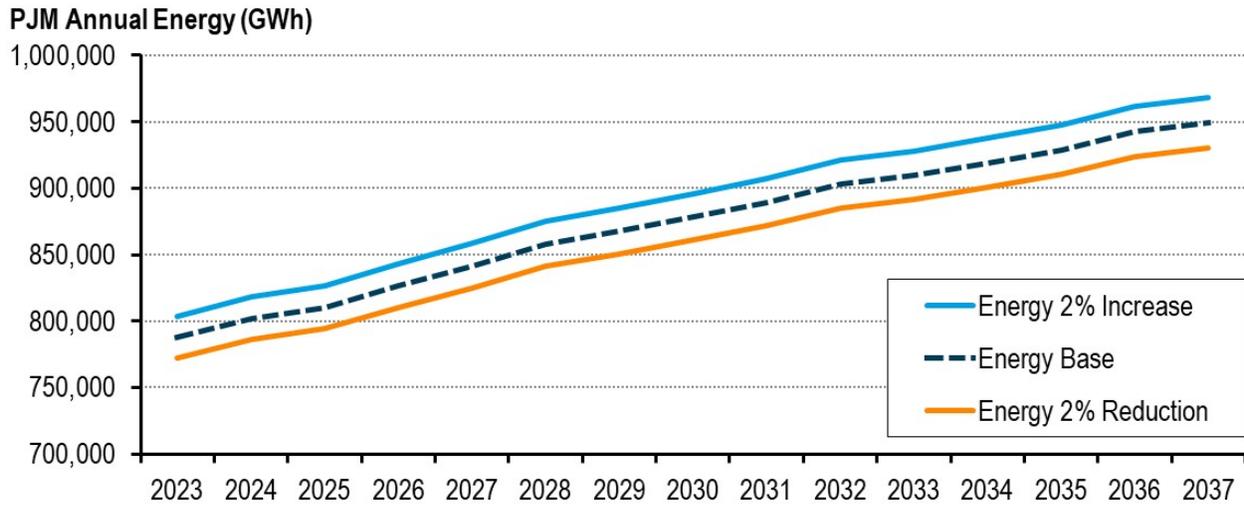

Gas Forecast Sensitivity

A +/- 20% variation of the Henry Hub gas price is used to test the robustness of eligible solution proposals. **Figure 7** shows a graph of the annual Henry Hub price for the base case and the two sensitivity cases (20% Henry Hub reduction and 20% Henry Hub increase) for years 2023 through 2037.


Figure 7. Gas Sensitivity

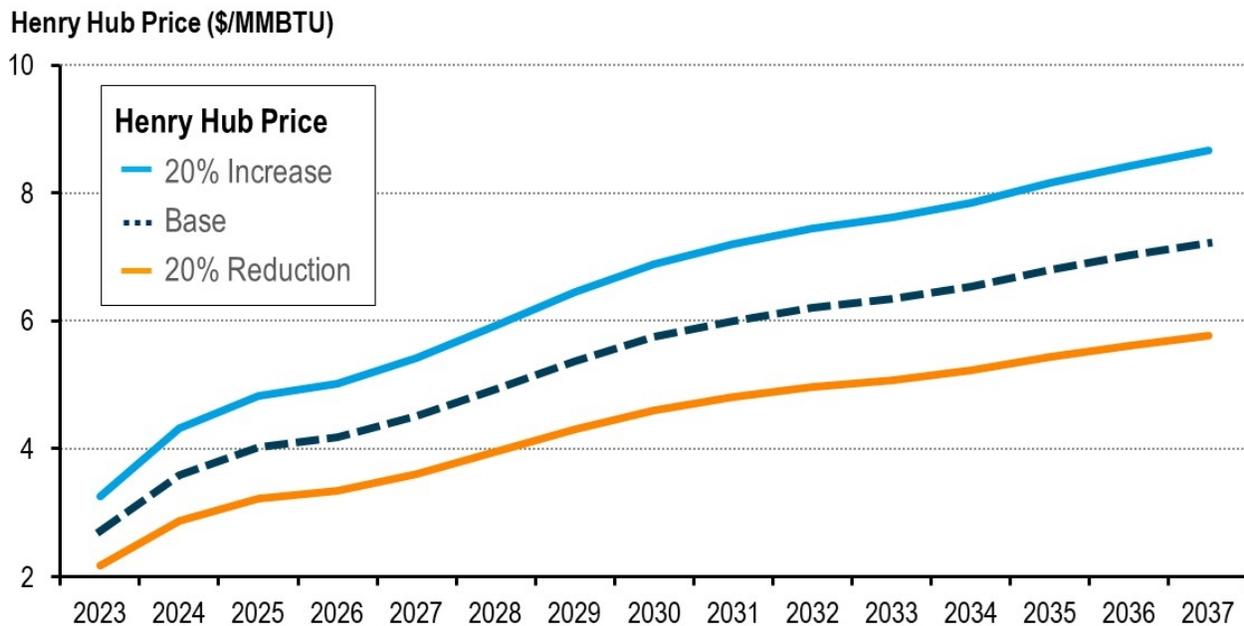

Generation Sensitivity – Facility Study Agreement (FSA) Level

Additional modeled generating capacity will be considered to test the robustness of eligible solution proposals. In addition to the capacity modeled in the base case that includes capacity that is in-service plus active queue generation at the ISA level minus announced future deactivations, the generation sensitivity also includes active queue generation at the FSA level.

Figure 8. PJM Market Efficiency Reserve Margin With Uniform Expansion (Includes FSA Level)

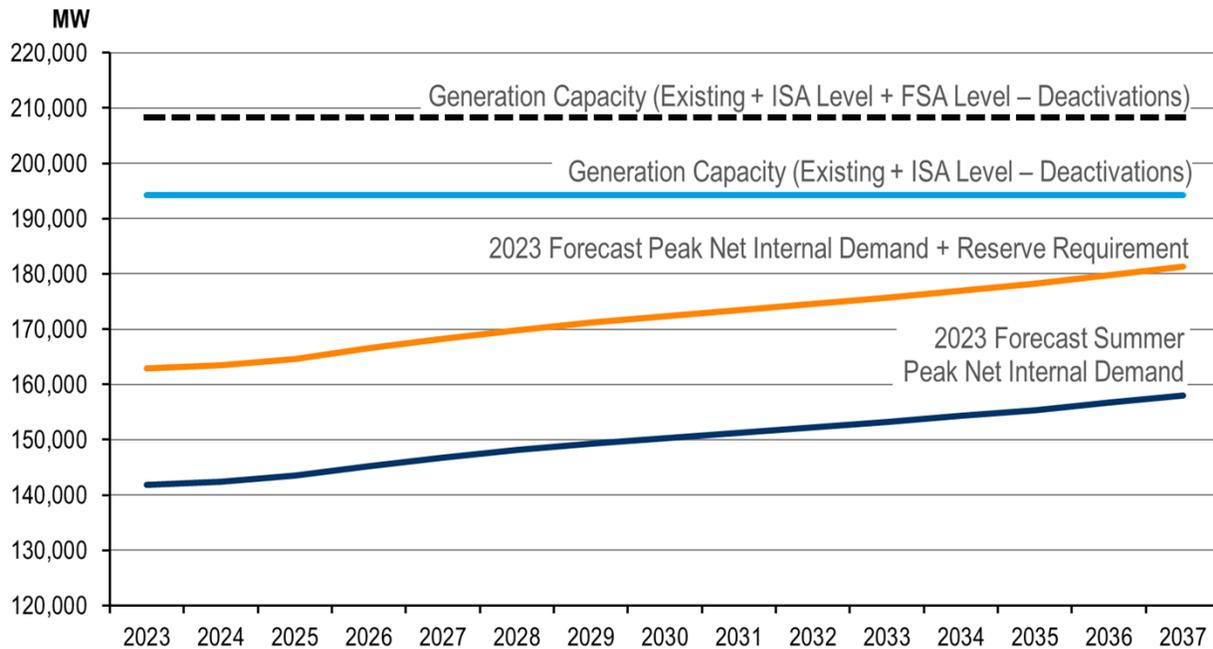

Notes: Generation includes existing and projected PJM internal capacity resources. Solar and wind resource capacity at 38% and 13% of maximum capability, respectively. Model informed by 2027 RTEP Powerflow and the Generation Interconnection Queue.

Evaluation of Generation Trends

Additional generating capacity sensitivities may be considered to test the robustness of eligible solution proposals. The additional generation sensitivities being considered need to be coordinated and defined in conjunction with other corporate studies that are ongoing. These would be based on modeling of generation capacity assumptions represented within the New Jersey SAA study, Generation at Risk Analysis, and Grid of the Future Modeling that is expected to incorporate a view of the Illinois Climate and Equitable Jobs Act implementation (CEJA).