




# Load Management Performance AEP\_MARION LM Subzone June 14-15-16, 2022

DRS

12/5/22



# AEP\_MARION Load Management Subzone

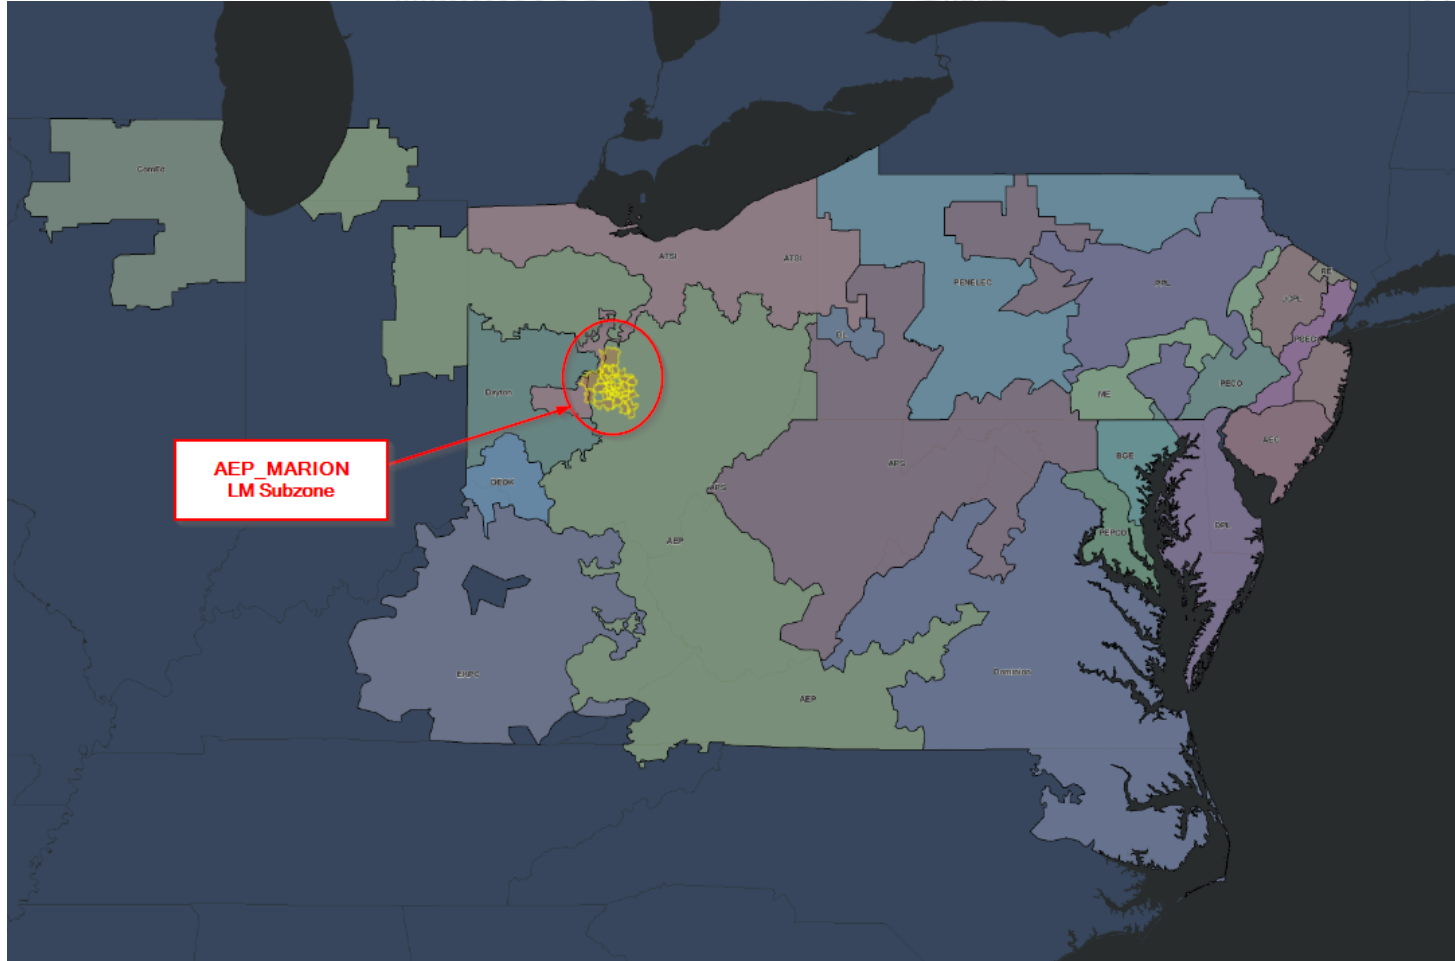


Created in response to line trippings in the area


- Dispatch of Load Management was part of a larger effort to address the transmission system problem near Columbus, OH
- Load Management (LM) Subzone created the morning of June 14 for immediate use
- Events spanned 3 days and totaled 21 hours of load reductions
- PJM dispatched Pre-Emergency and Emergency, All Lead Times (30, 60, 120 minutes), CP DR resources




# Load Management Event Timing – June 14, 15, 16, 2022

Load Management Events, AEP MARION Subzone				
Both Pre-Emergency and Emergency Product Types Deployed Simultaneously				
<b>14-Jun</b>				
<b>Lead Time</b>	Notice	Start	End	Run Time
<b>Quick_30</b>	15:50	16:20	22:00	05:40
<b>Short_60</b>	15:50	16:50	22:00	05:10
<b>Long_120</b>	15:50	17:50	22:00	04:10
<b>15-Jun</b>				
<b>Lead Time</b>	Notice	Start	End	
<b>Quick_30</b>	10:50	11:20	22:00	10:40
<b>Short_60</b>	10:50	11:50	22:00	10:10
<b>Long_120</b>	10:50	12:50	22:00	09:10
<b>16-Jun</b>				
<b>Lead Time</b>	Notice	Start	End	
<b>Quick_30</b>	12:30	13:00	17:00	04:00
<b>Short_60</b>	12:30	13:30	17:00	03:30
<b>Long_120</b>	12:30	14:30	17:00	02:30

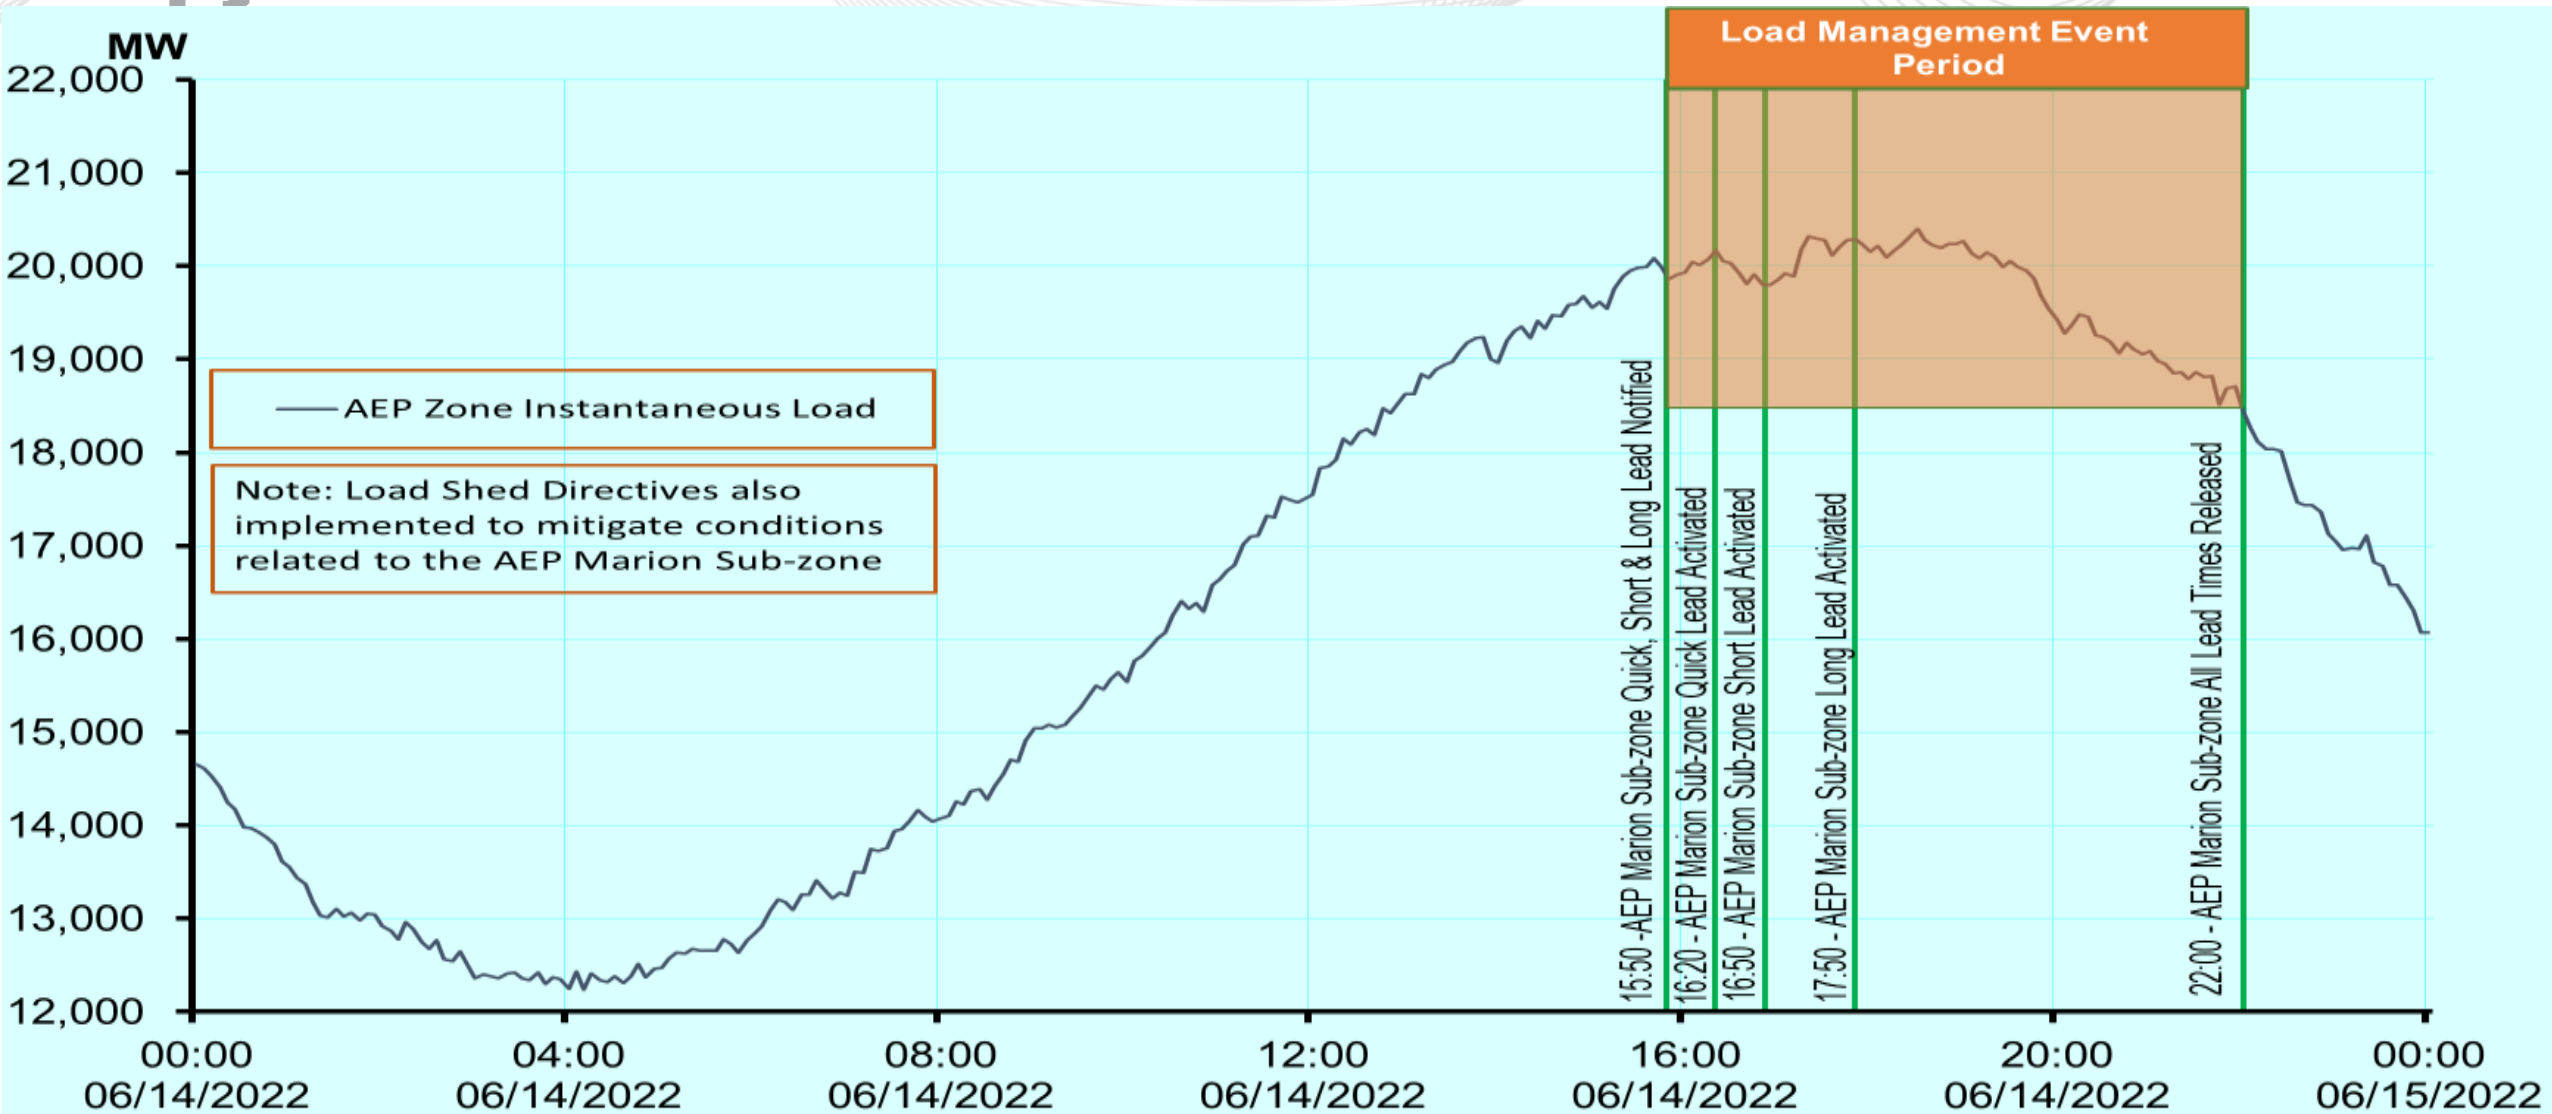

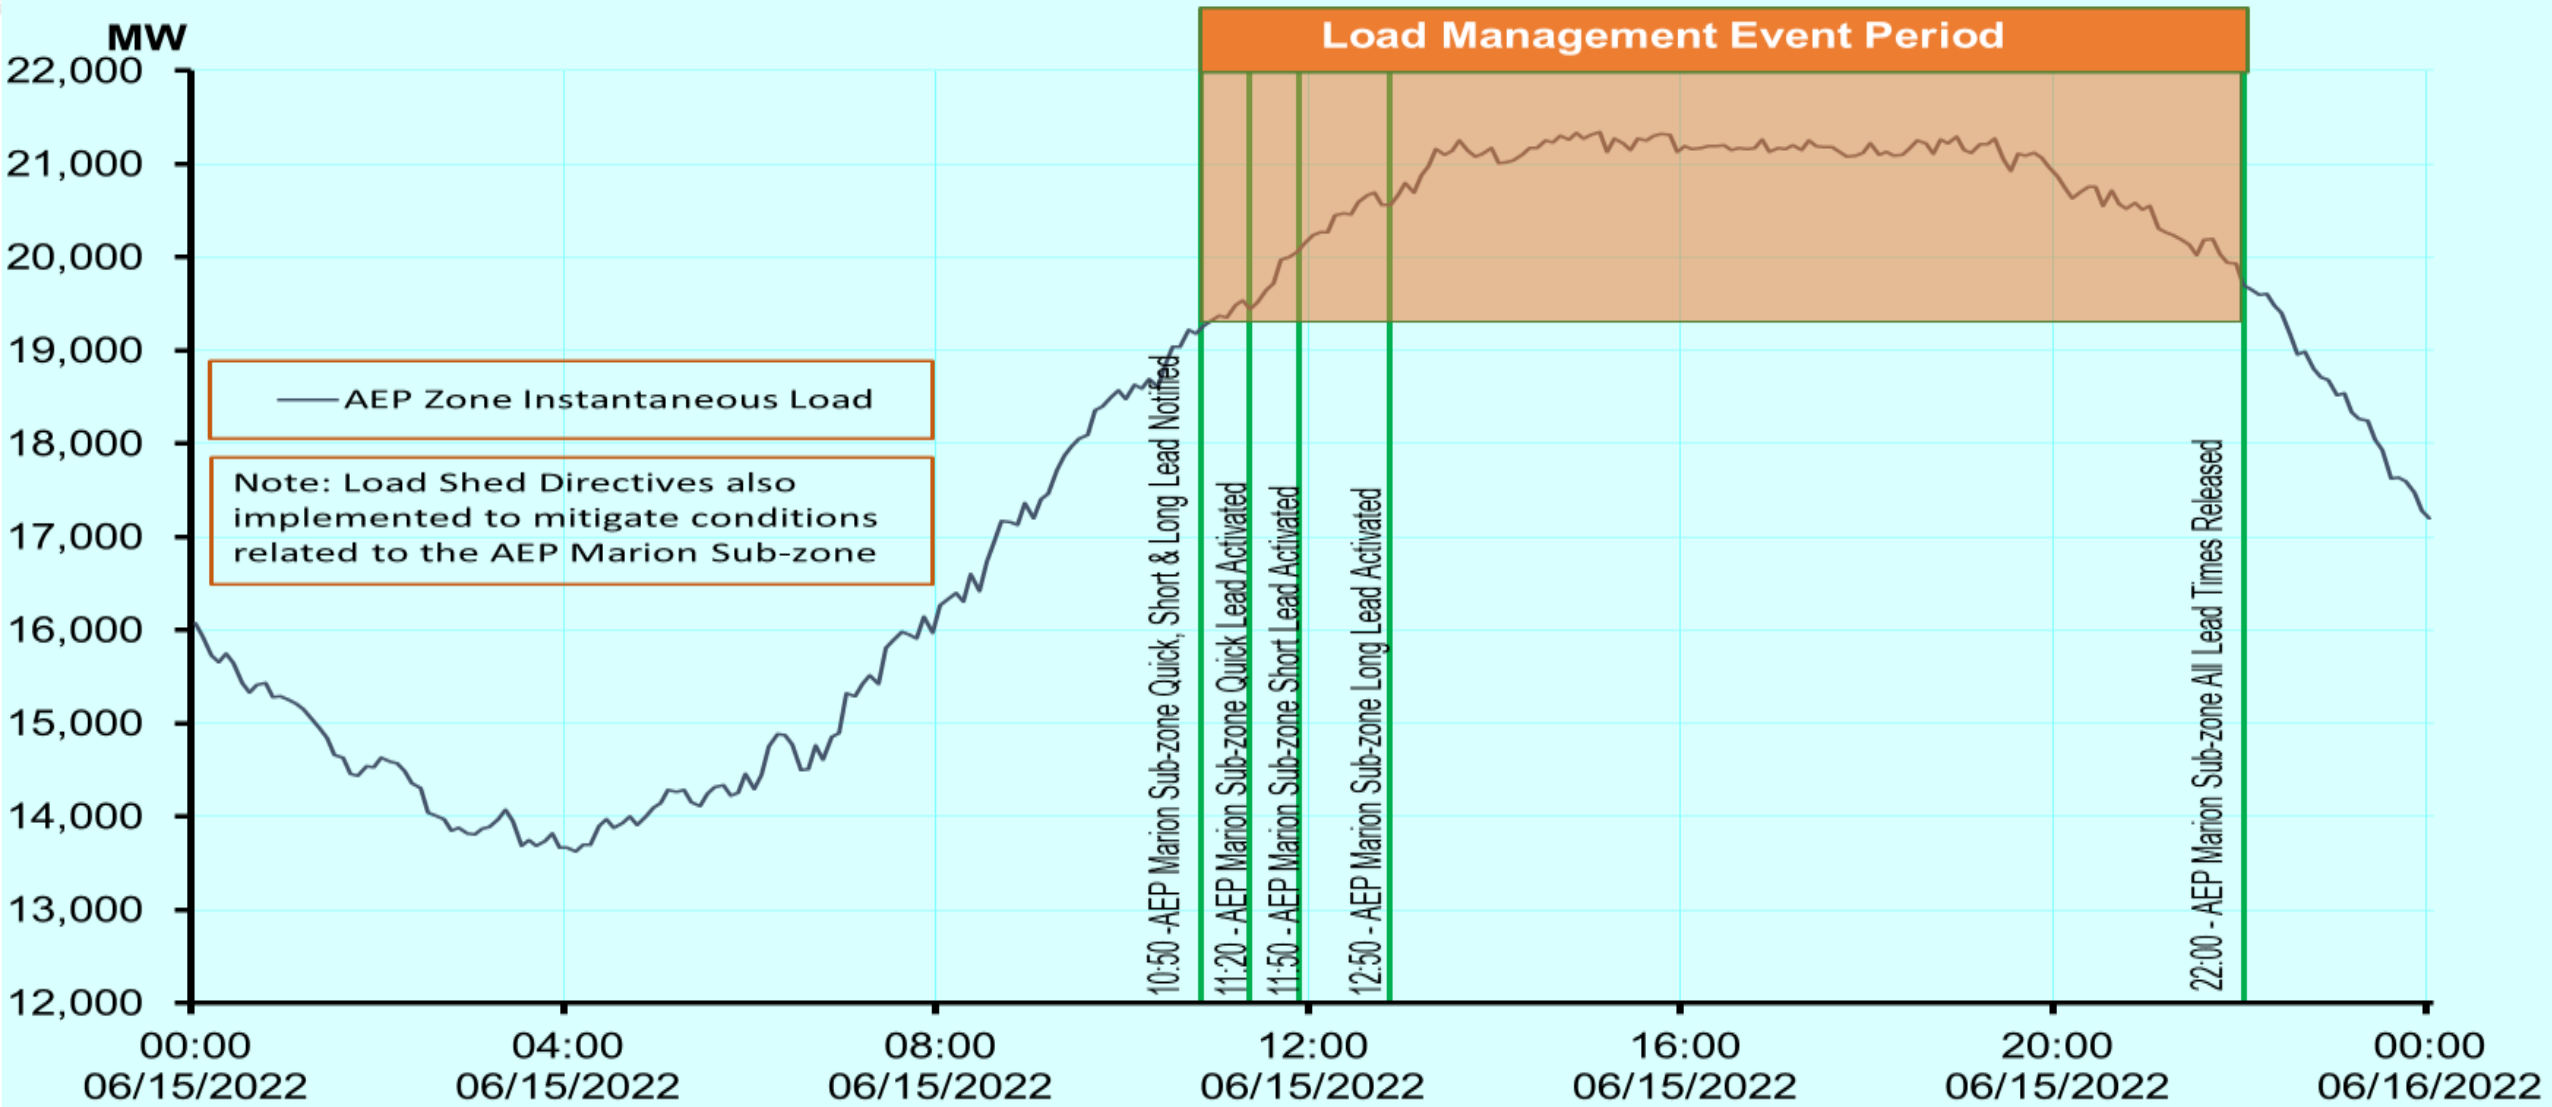

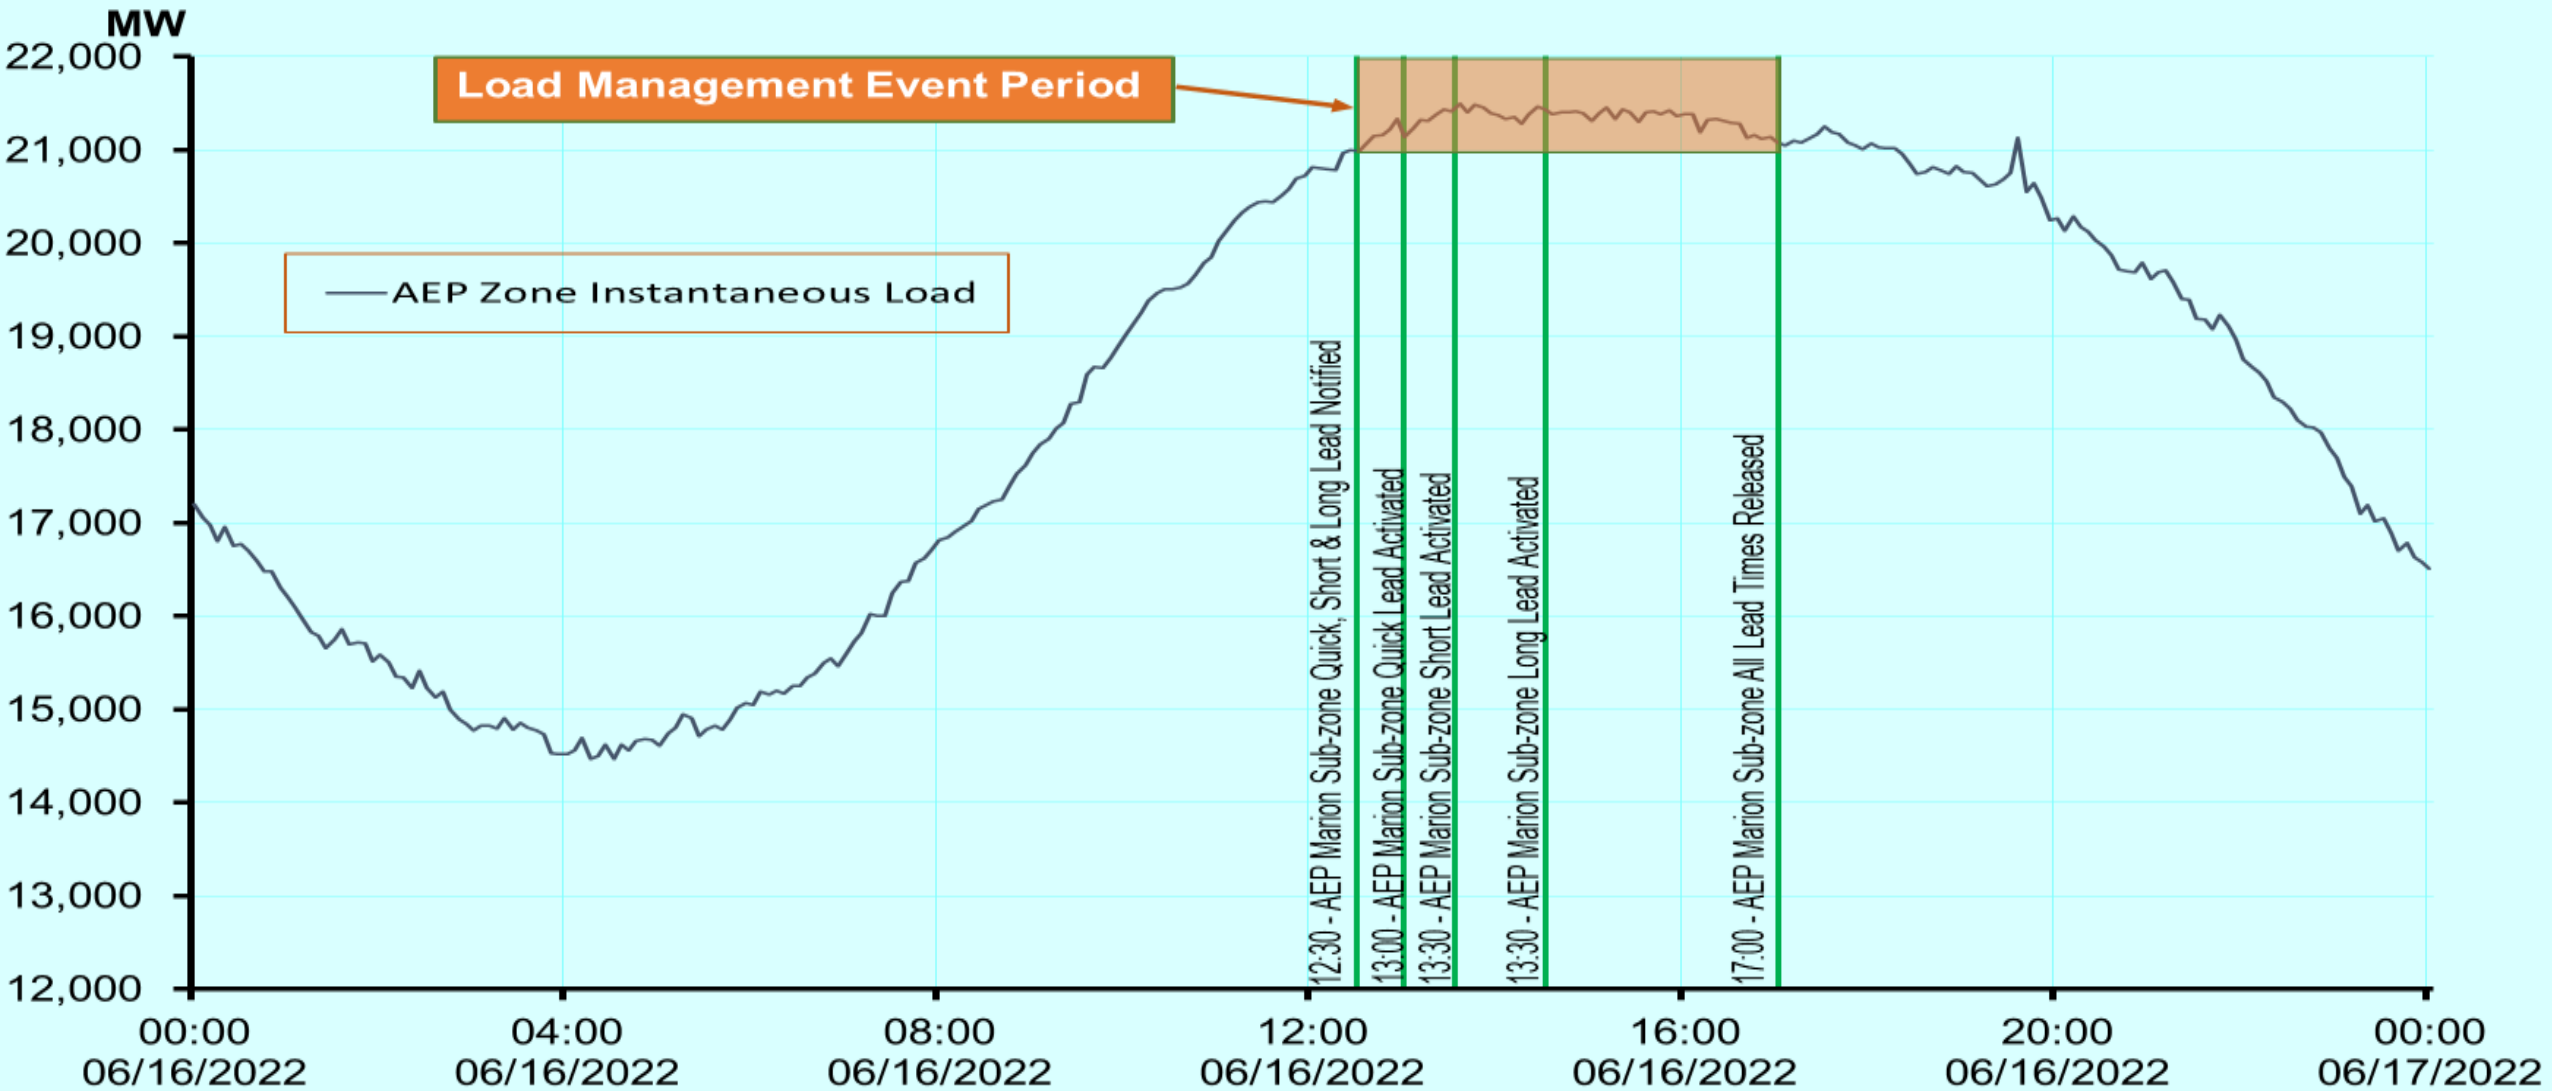





# Performance over three Days/21 Hours

Hourly average performance over all hours was ~86%


June 15, 2022  
AEP\_MARION

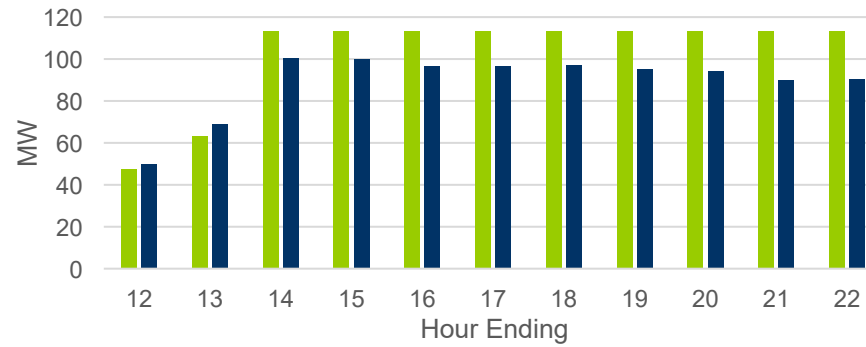

June 14, 2022  
AEP\_MARION

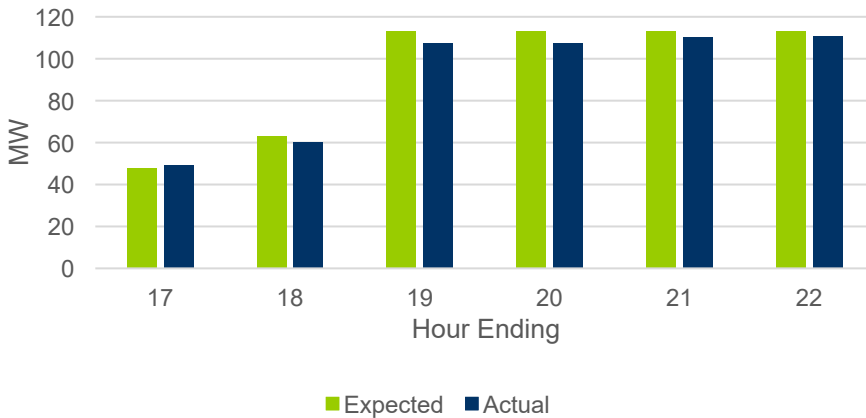

June 16, 2022  
AEP\_MARION

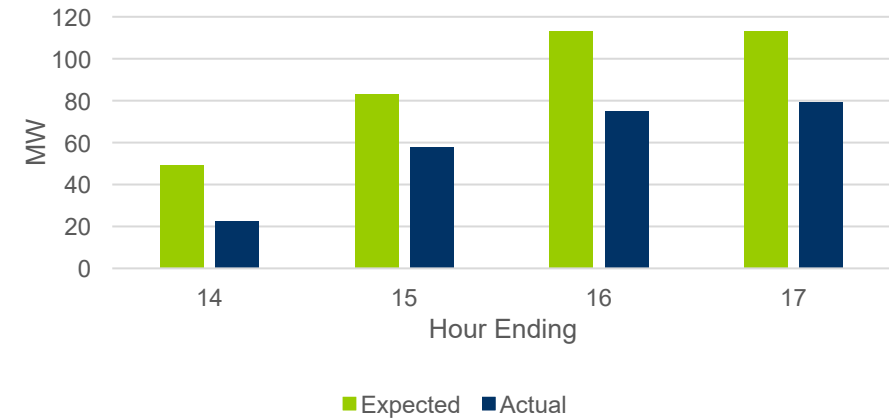



Presenter:  
[Jack O'Neill, [jack.oneill@pjm.com](mailto:jack.oneill@pjm.com)  
**[LM Performance AEP\_MARION SZ]**



### Member Hotline

(610) 666 – 8980

(866) 400 – 8980

[custsvc@pjm.com](mailto:custsvc@pjm.com)

**PROTECT THE  
POWER GRID**  
**THINK BEFORE  
YOU CLICK!**



Be alert to  
malicious  
phishing emails.

**Report suspicious email activity to PJM.**  
(610) 666-2244 / [it\\_ops\\_ctr\\_shift@pjm.com](mailto:it_ops_ctr_shift@pjm.com)

